

Wilton Fire Department

Permit Application – Liquid Storage

FEE= \$35.00

Paid Via: _____

PERMIT# _____

	Permit application to install a LIQUID PROPANE storage container > 20 gallons.
	Permit application to install an OIL storage container > 100 gallons.
	Permit application to PERMANENTLY REMOVE an oil storage container.

Property Address: _____ Map/Lot # _____

Property Owner: _____

Name of Installer: _____ GAS LICENSE # _____

Expiration Date: _____ Gas Fitter's Cell Phone # _____

Email: _____

INSTALLER SHALL SHOW LICENSE AND PHOTO ID WITH APPLICATION

Company Name: _____

Address: _____ Company Phone # _____

Container Capacity: _____ Gallons _____ Above Ground _____ Below Ground

Date of Installation: _____ Date of Permanent Removal: _____

On reverse, show the following details:

OVER ►►►►►►►

- Container Location
- Distance to buildings & lot lines
- Location of roads, driveways, parking lots
- Proposed container protection methods.

Date

Signature of Applicant

I understand my signature verifies installation is compliant with all State NH adopted codes including those adopted by reference. ASME, RSA 135:5, Saf-C 6012, NFPA, UL, CSA America including ANSI Z223.1-2015.

Inspected and Approved

NOT Approved


Date: _____

Fire Inspector

Wilton Fire Department

Permit Application – Liquid Storage

Please Sketch Diagram: Reference NFPA 58, NFPA 31.

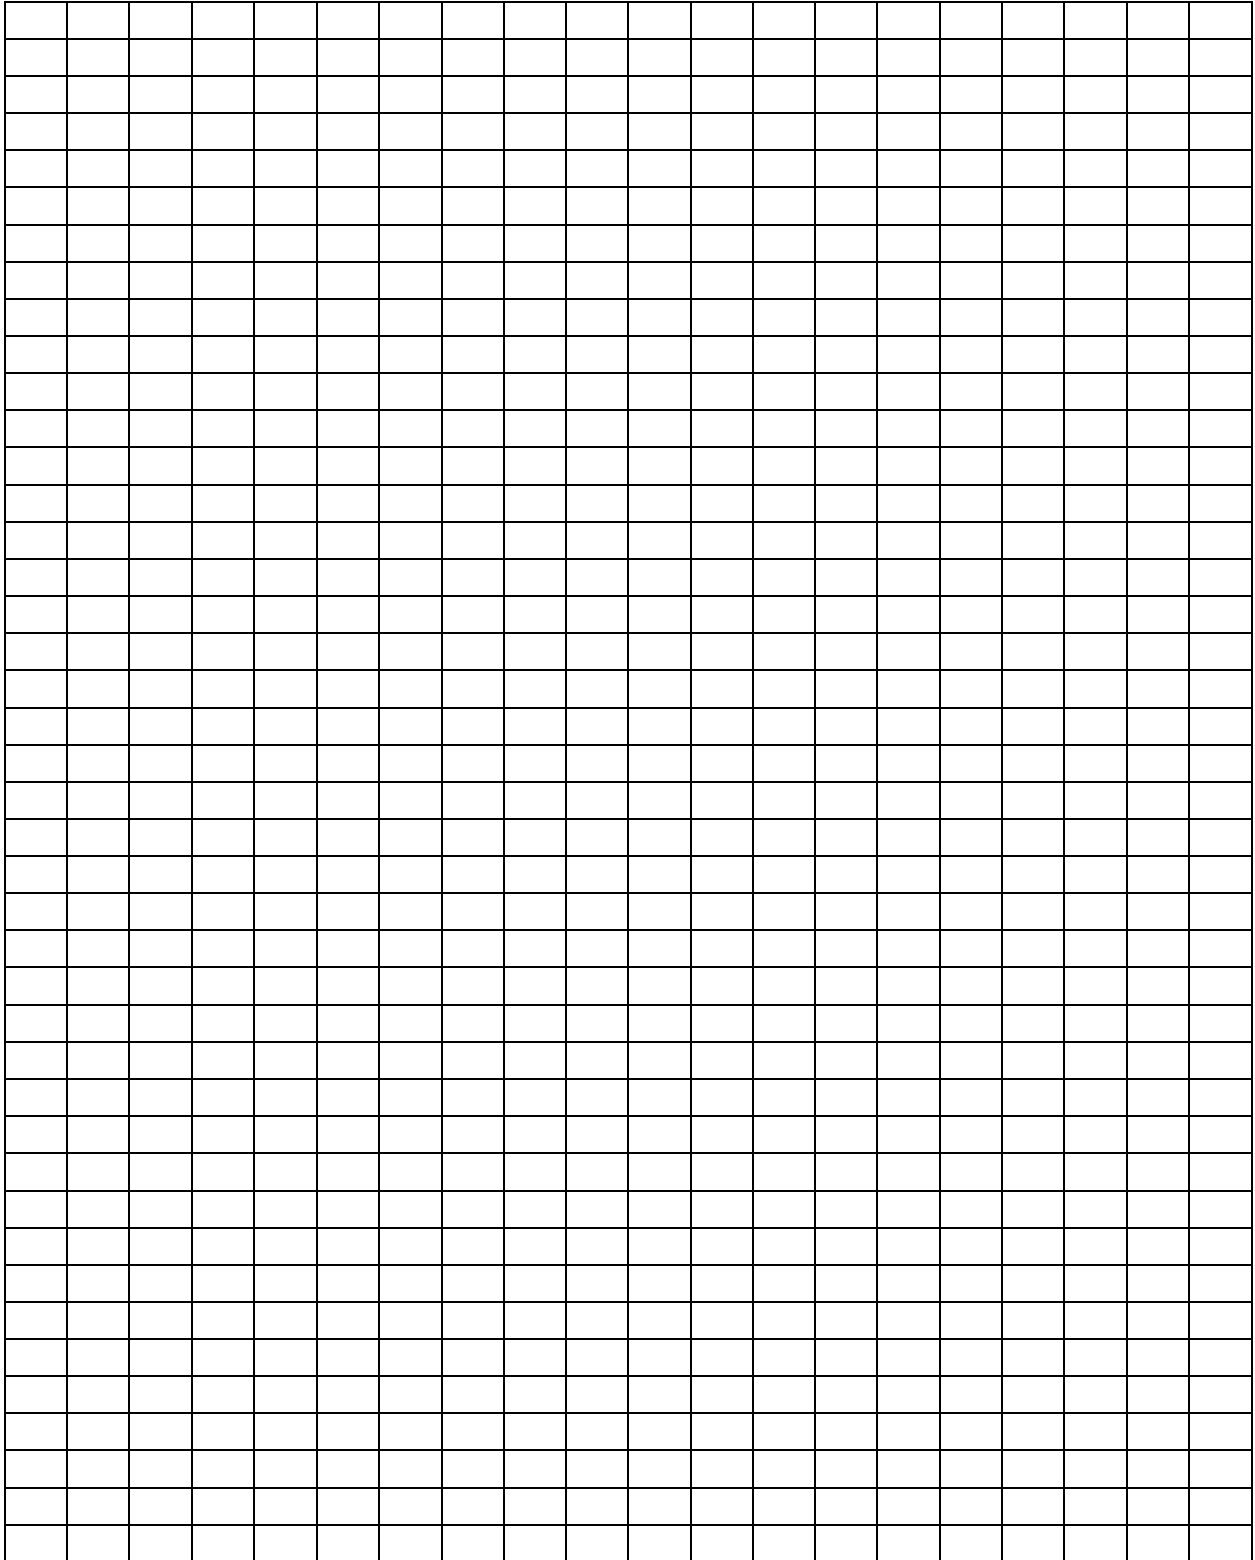

07/15/2021