


- NOTES:**
1. SYSTEM SIZING SHALL BE COMPLETED BY A FIRE SUPPRESSION ENGINEER AND APPROVED OF BY THE VILLAGE OF PLEASANT PRAIRIE FIRE DEPARTMENT.
  2. SYSTEM INSTALLATION MUST BE CONSTRUCTED UNDER THE ONSITE SUPERVISION OF A LICENSED SPRINKLER FITTER.
  3. WHEN POSSIBLE THE CHECK VALVE WITH BALL DRIP SHALL BE PLACED WITHIN THE BUILDING BASEMENT REMOVING THE NEED FOR THE MANHOLE STRUCTURE. THE BALL DRIP SHALL BE A MIN. 6" BELOW THE SURFACE ELEVATION OF THE PUMPER PAD IN EITHER LOCATION.

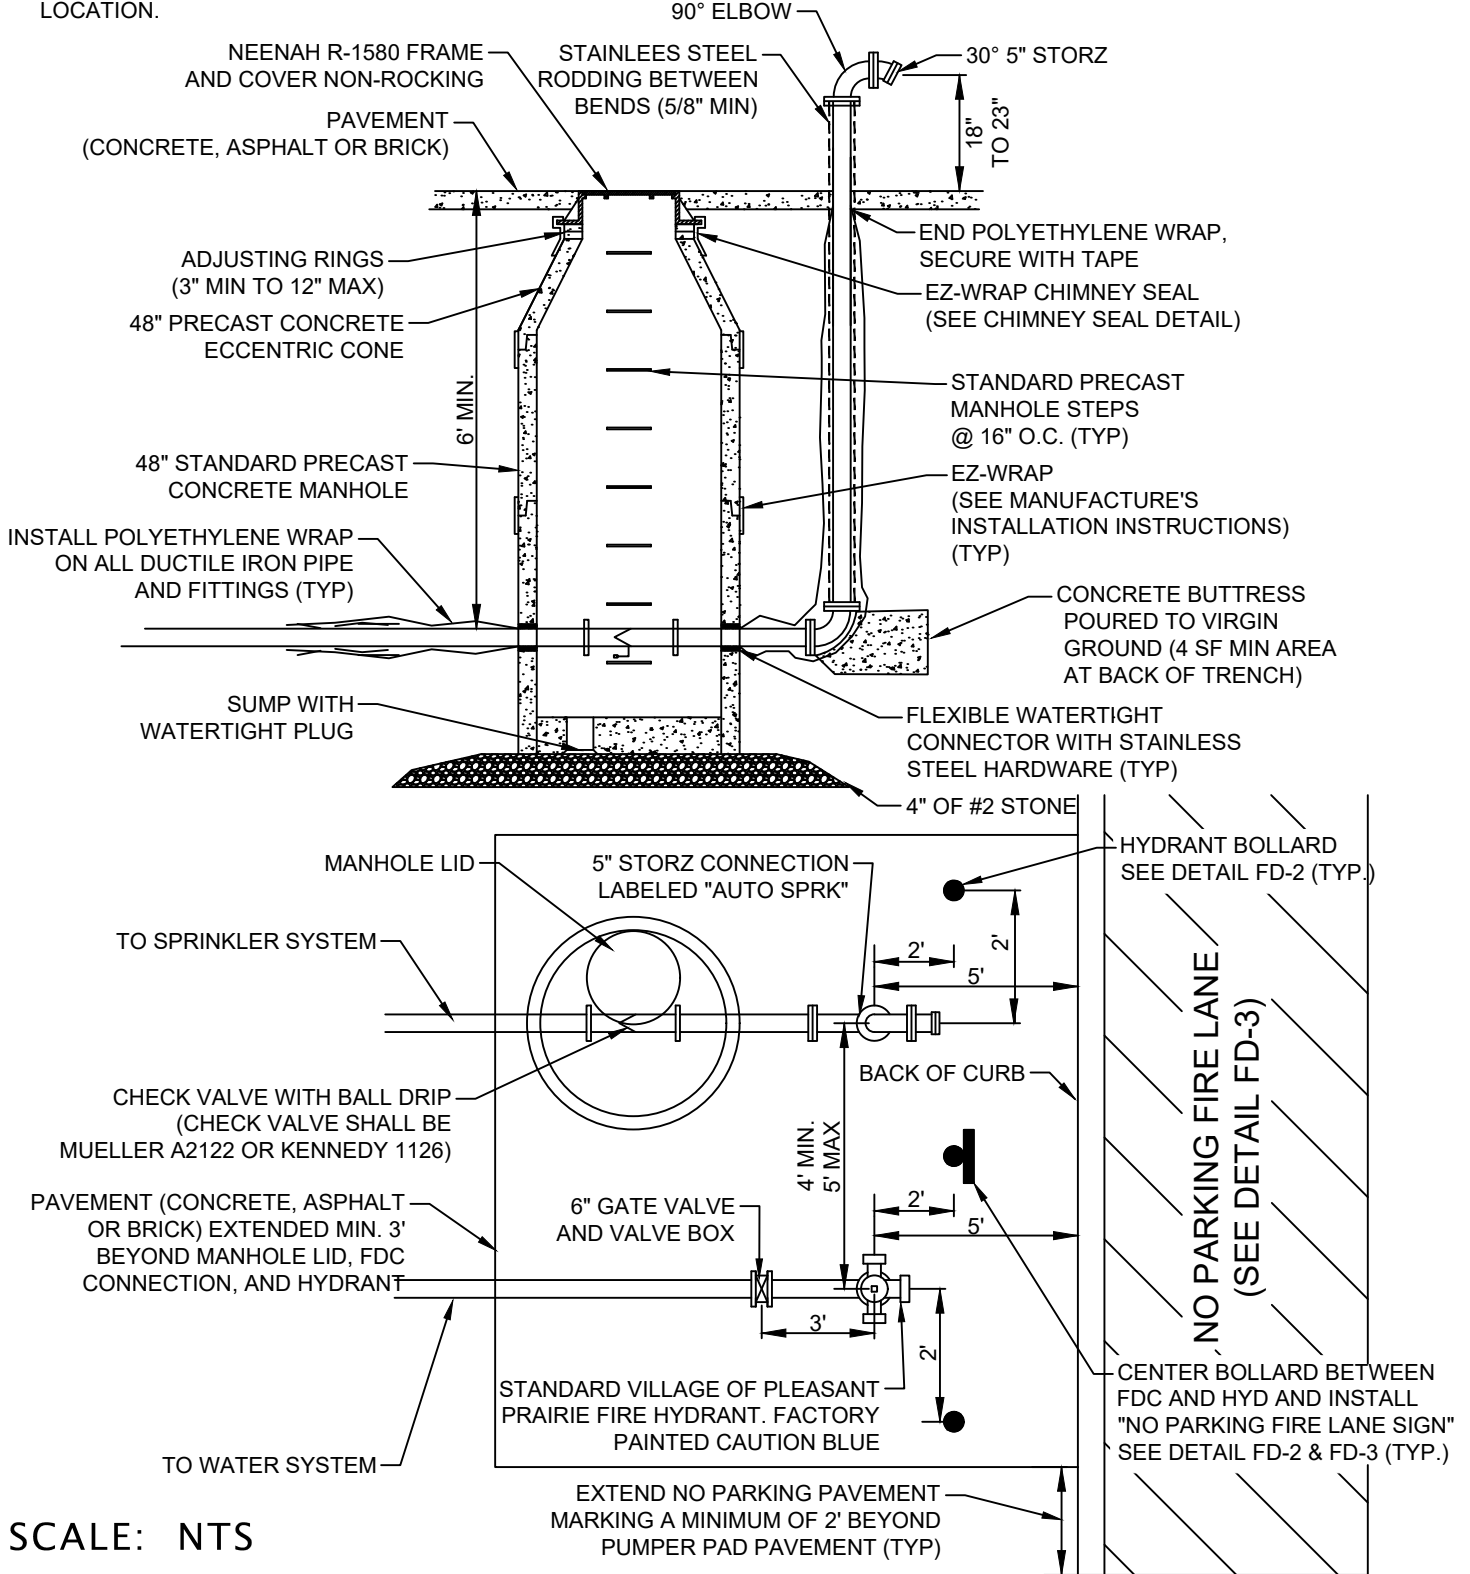

SCALE: NTS

**PUMPER PAD FDC DETAIL**

DETAIL: FD - 1

DATE: 9-10-20

APPROVED BY: C. ROEPKE

**VILLAGE OF PLEASANT PRAIRIE**  
 KENOSHA COUNTY, WISCONSIN