



NOTES

1. REFER TO VILLAGE STANDARD SPECIFICATIONS FOR TRACER WIRE.

SANITARY SEWER AND FORCE MAIN LIDS SHALL BE COLORED GREEN.
 WATER MAIN LIDS SHALL BE COLORED BLUE.
 STORM SEWER LIDS SHALL BE COLORED BROWN.
 ELECTRICAL LIDS SHALL BE COLORED RED.



CAST IRON LID

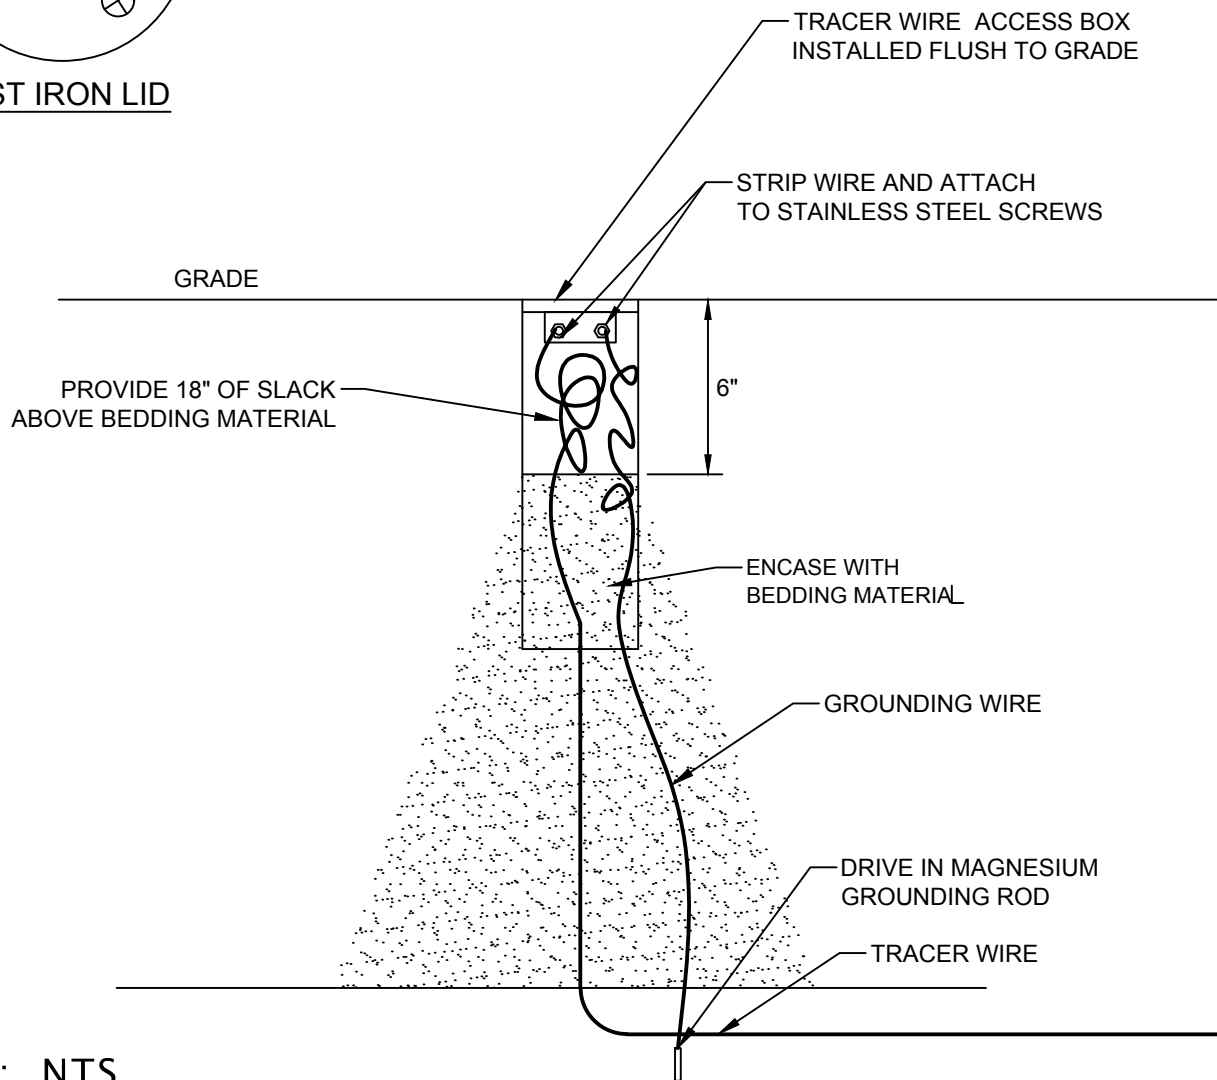

SCALE: NTS

TRACER WIRE ACCESS BOX

DETAIL: TW - 1

DATE: 12-17-18

APPROVED BY: MATT FINEOUR

VILLAGE OF PLEASANT PRAIRIE
 KENOSHA COUNTY, WISCONSIN